



### Figure 1. High Temperature Pressurized Loop (HTPL) Solar Heat Transfer System

126  
584


3700  
1-4

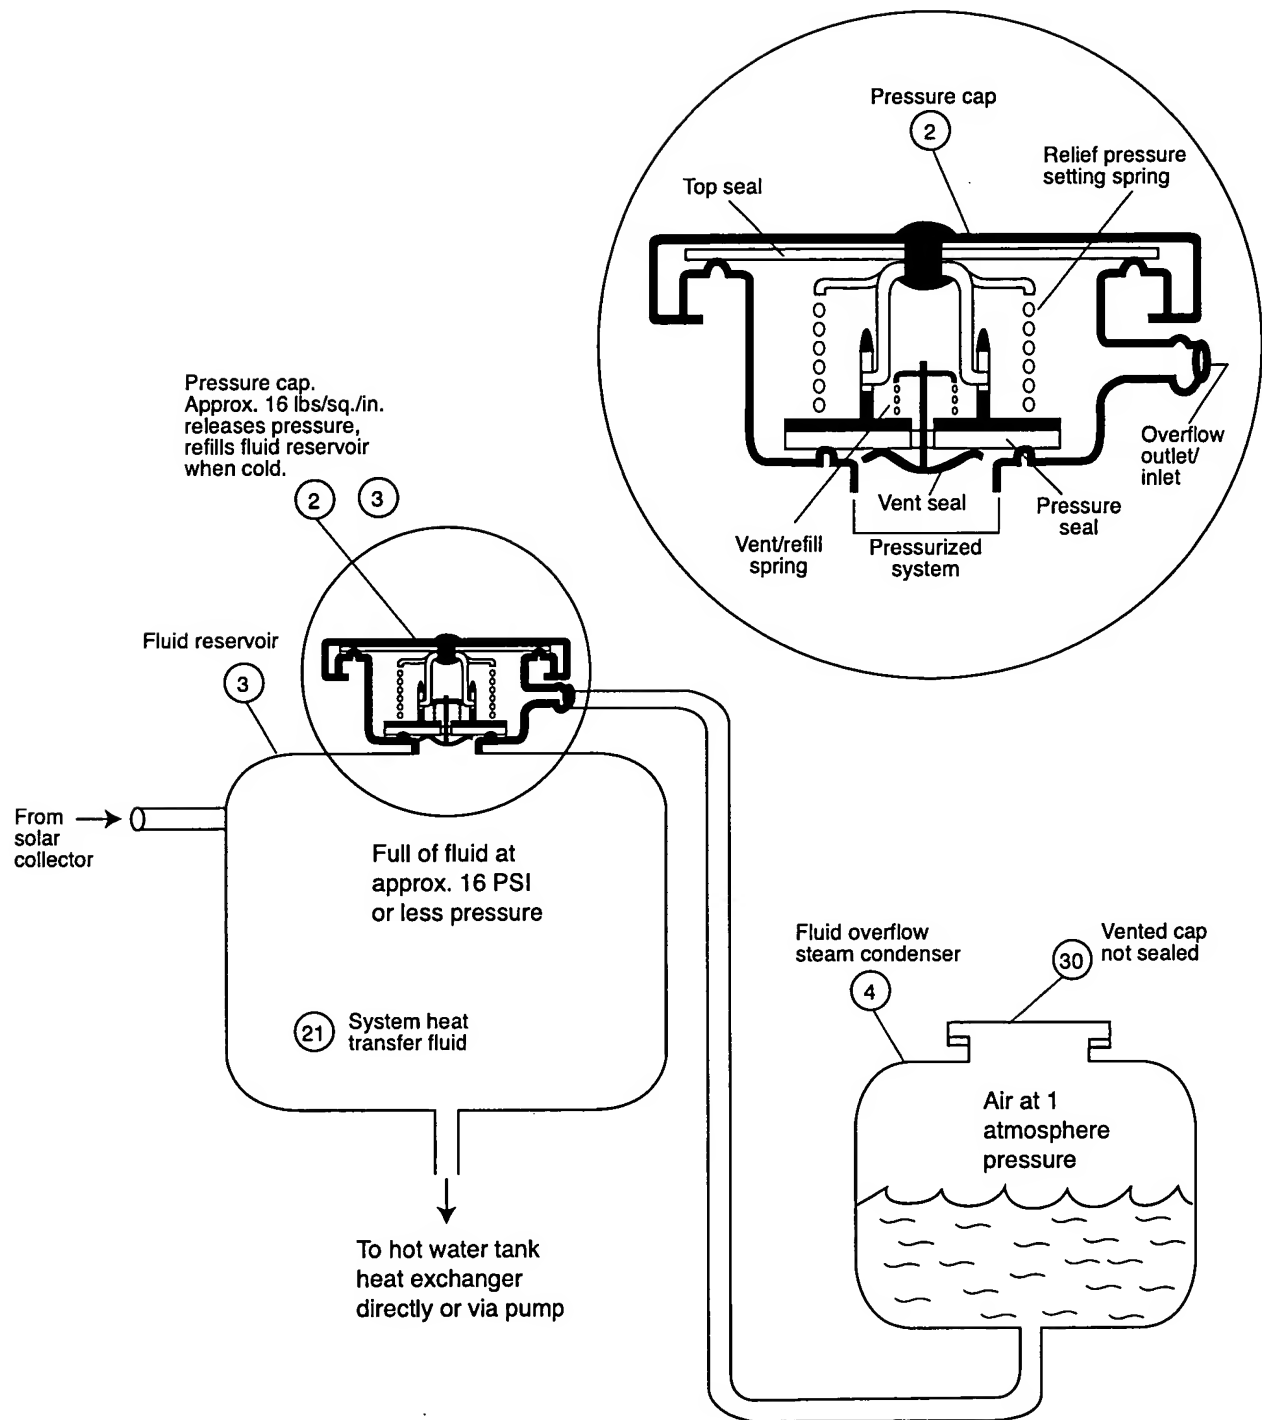

**Figure 2. Pressurizing and Fluid Recovery System**

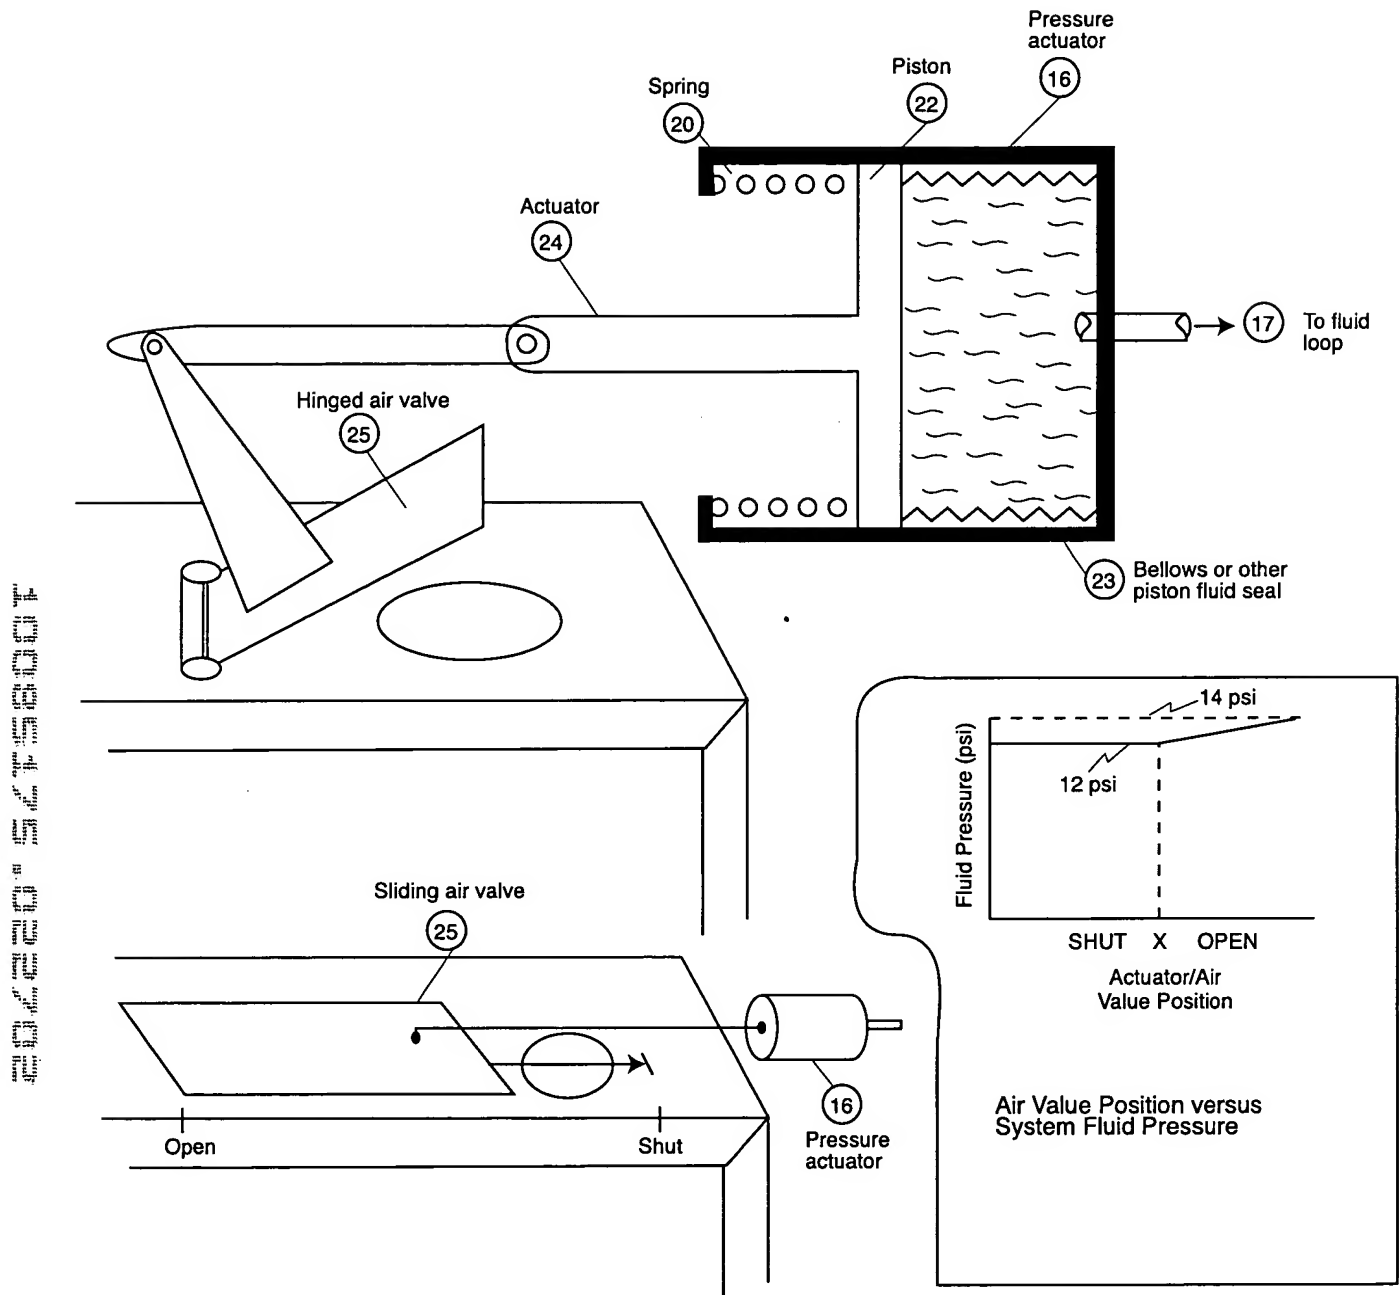

**Figure 3. Pressure Actuated Collector Cooling System which allows air to cool the collector if fluid flow stops or is not enough to stop boiling**

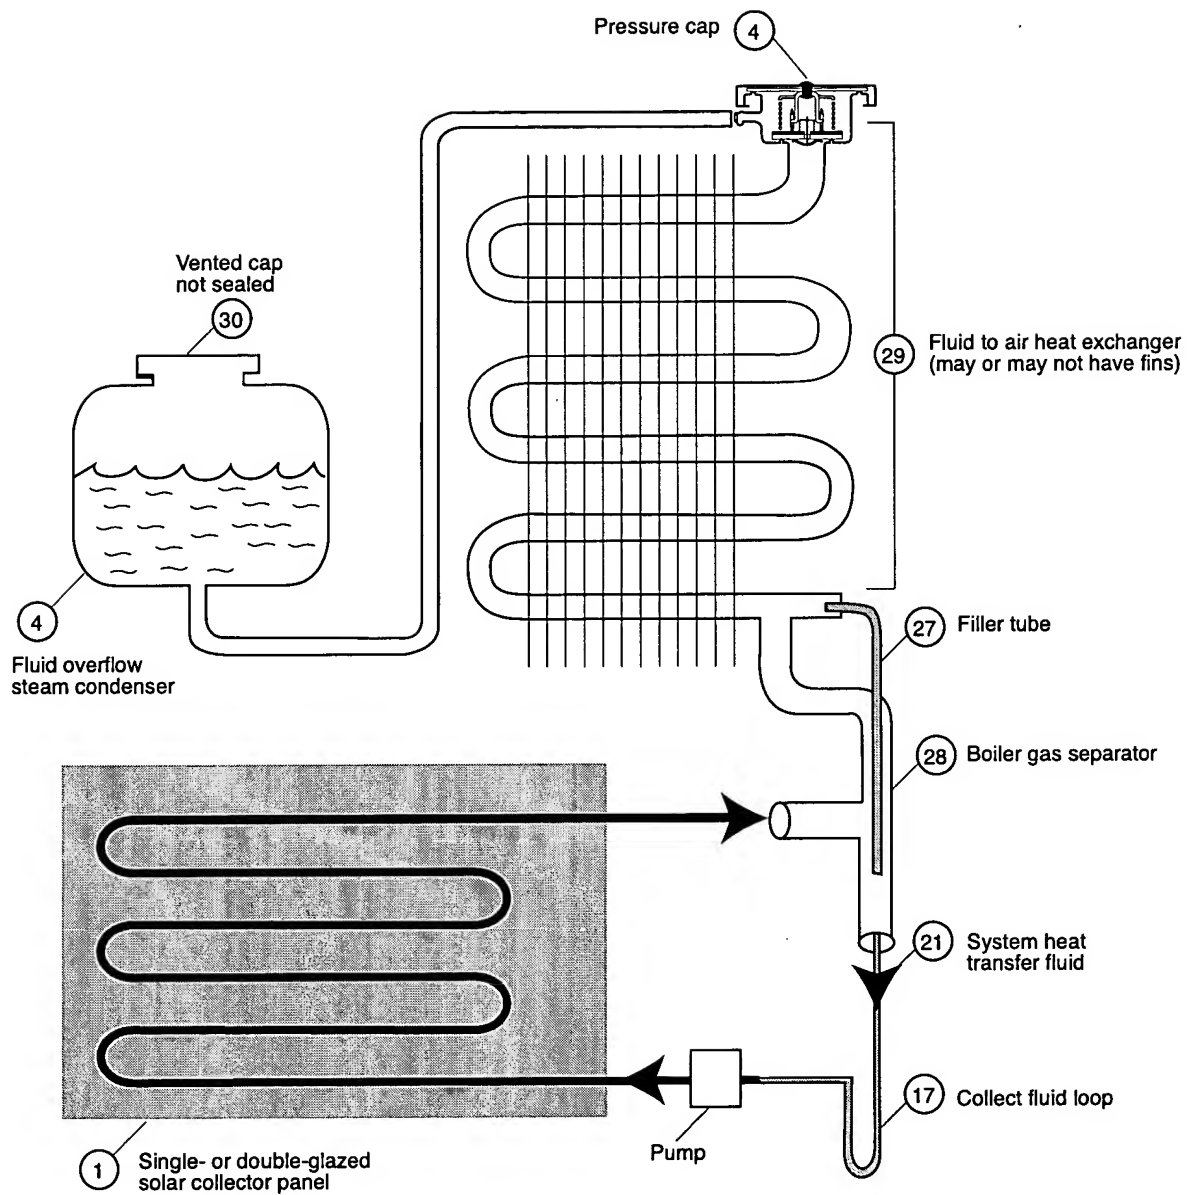

**Figure 4. Boiling Activated Collector Over Temperature Protection System**